




INSTALACIÓN DE FUERZA

250 KVA



C.G.

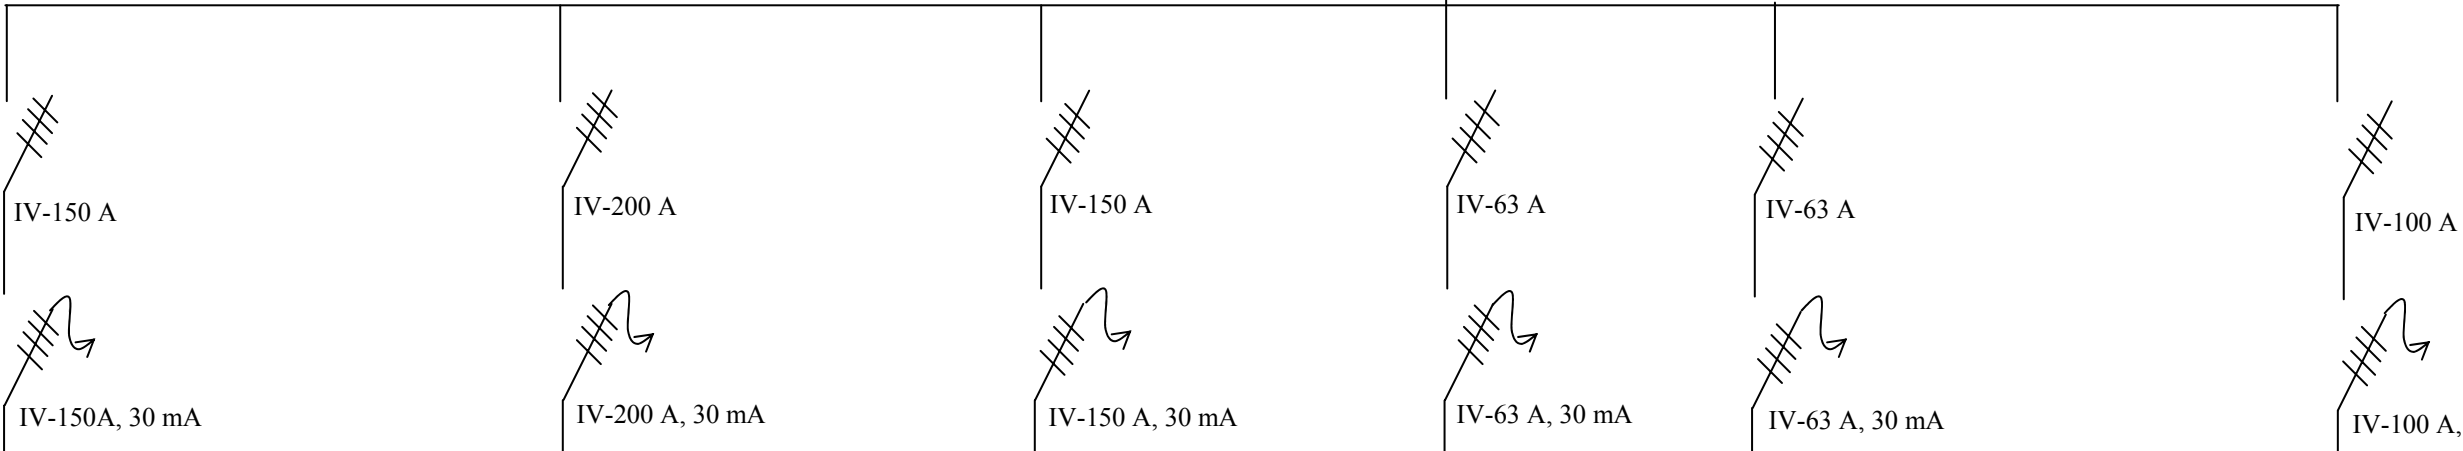

$3 \times 95 + 50 \text{ mm}^2 \phi 48 \text{ mm}$

$3 \times 120 + 70 \text{ mm}^2 \phi 48 \text{ mm}$

$3 \times 95 + 50 \text{ mm}^2 \phi 48 \text{ mm}$

$3 \times 16 + 16 \text{ mm}^2 \phi 29 \text{ mm}$

$3 \times 25 + 25 \text{ mm}^2 \phi 29 \text{ mm}$

$3 \times 70 + 70 \text{ mm}^2 \phi 29 \text{ mm}$

C.S.1




C.S.2

C.S.3

C.S.4

C.S.5

C.S.6

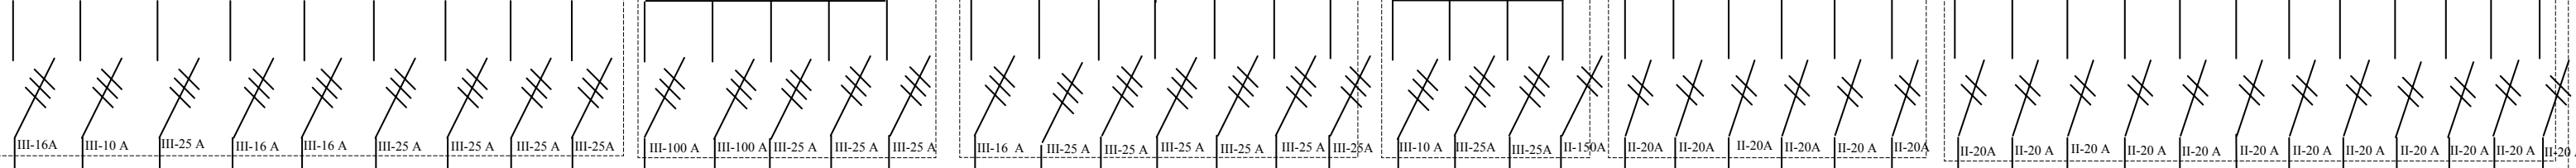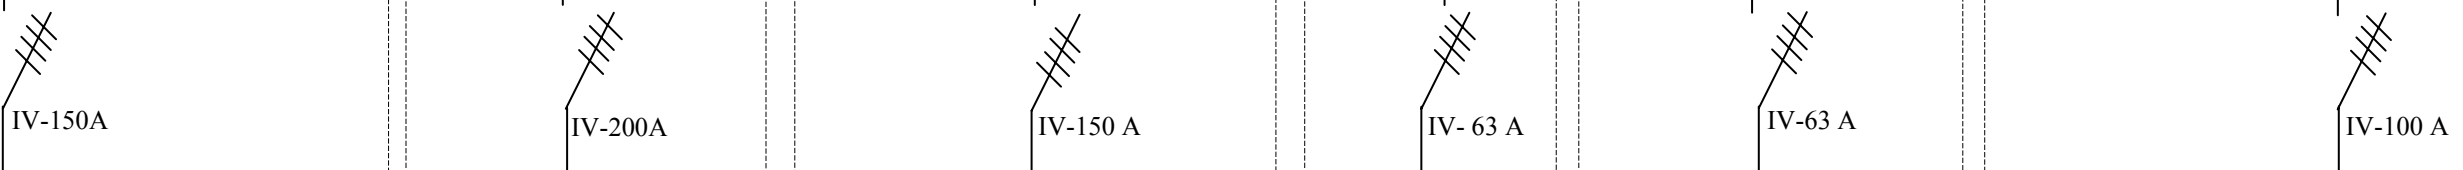

LINEA A

LÍNEA B

LINEA C

LÍNEA D

LÍNEA E

LÍNEA F